

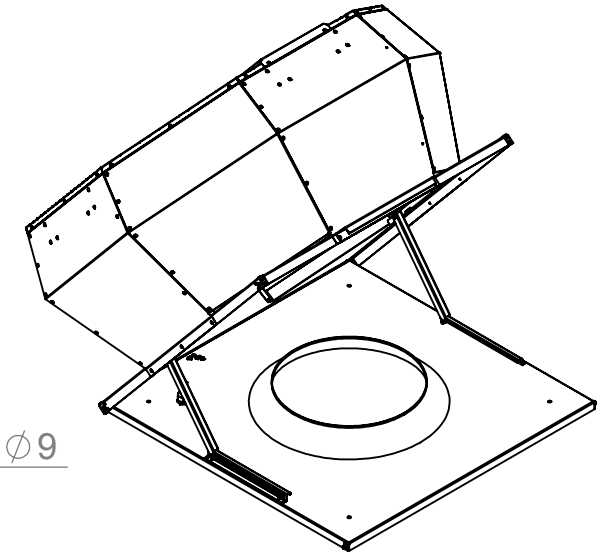


Cable outlet

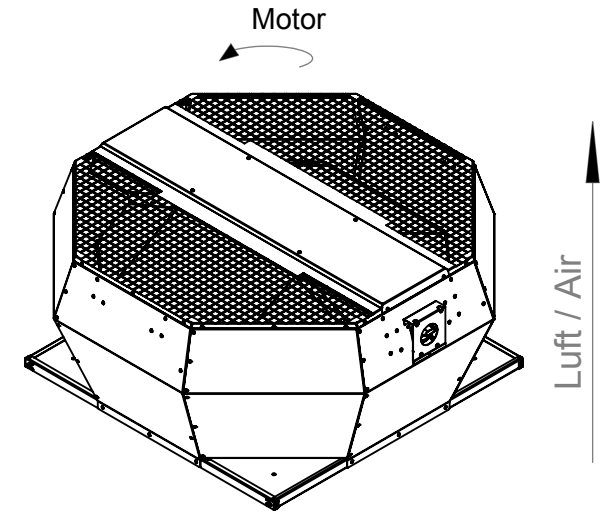

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

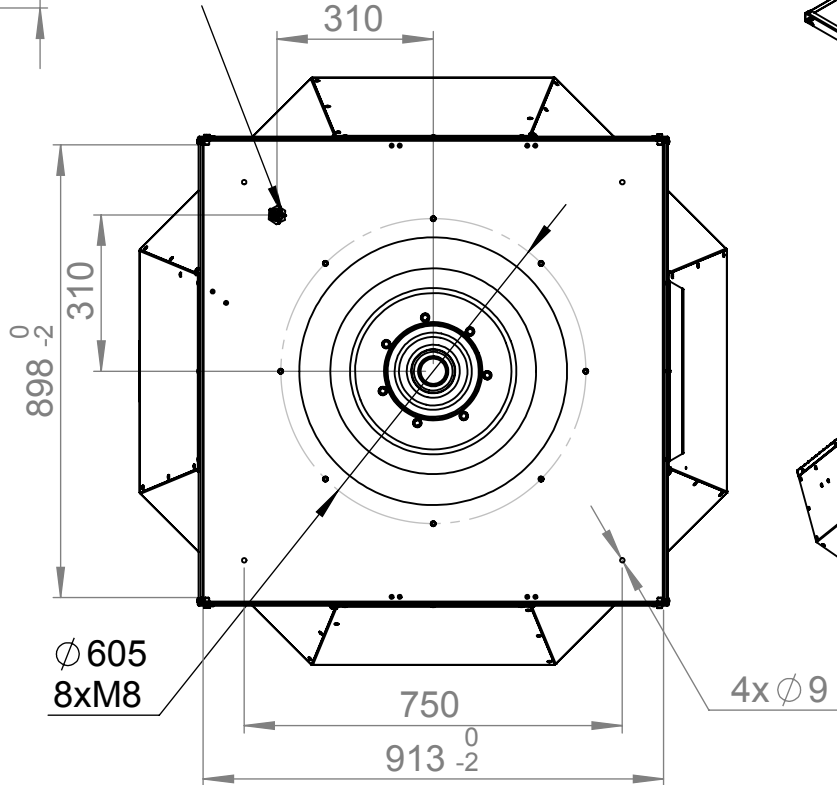

Protection Mark
according to ISO16016

Drawn: s.pop
Created: s.pop
Changed:

1:15 A4 mm

General tolerances
DIN ISO 2768-c

DVA560ECP31

139239 00