



100 ±5

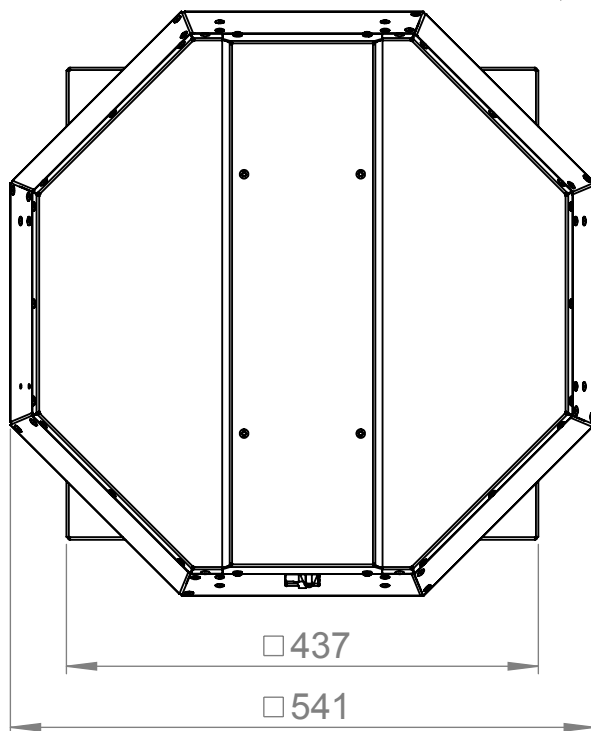

□437


□541

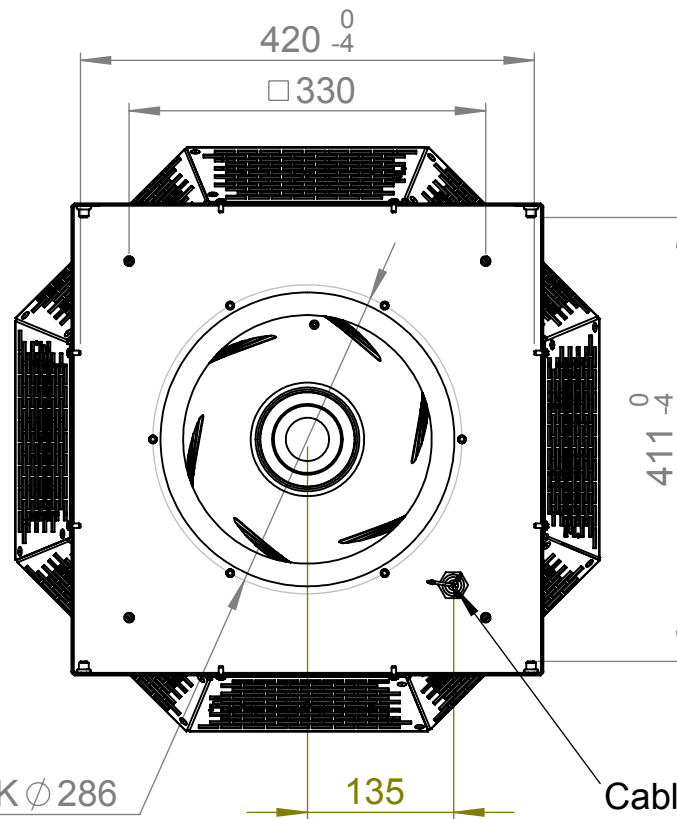

LK Ø 286

135


Cable outlet

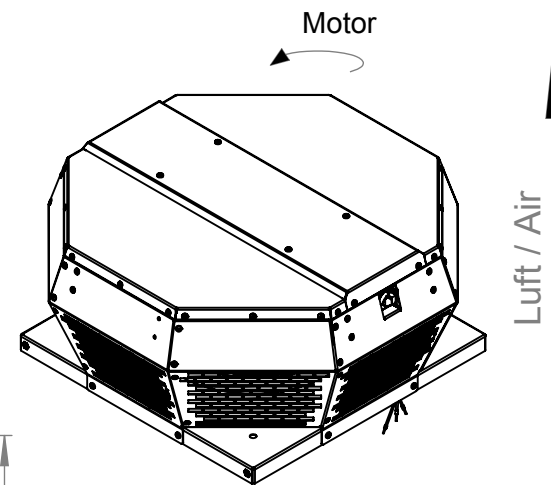

Motor

Luft / Air

ruck
 ruck Ventilatoren
 Max-Planck-Str. 5
 D-97944 Boxberg



Protection Mark
 according to ISO 16016
 Created d.hancu
 Drawn d.hancu
 Released d.hancu
 Disabled

1:7 A4 mm

General tolerances
 DIN ISO 2768-c
 07.12.2020
 07.12.2020
 10.03.2021

DHA315E4P42

156501 00